


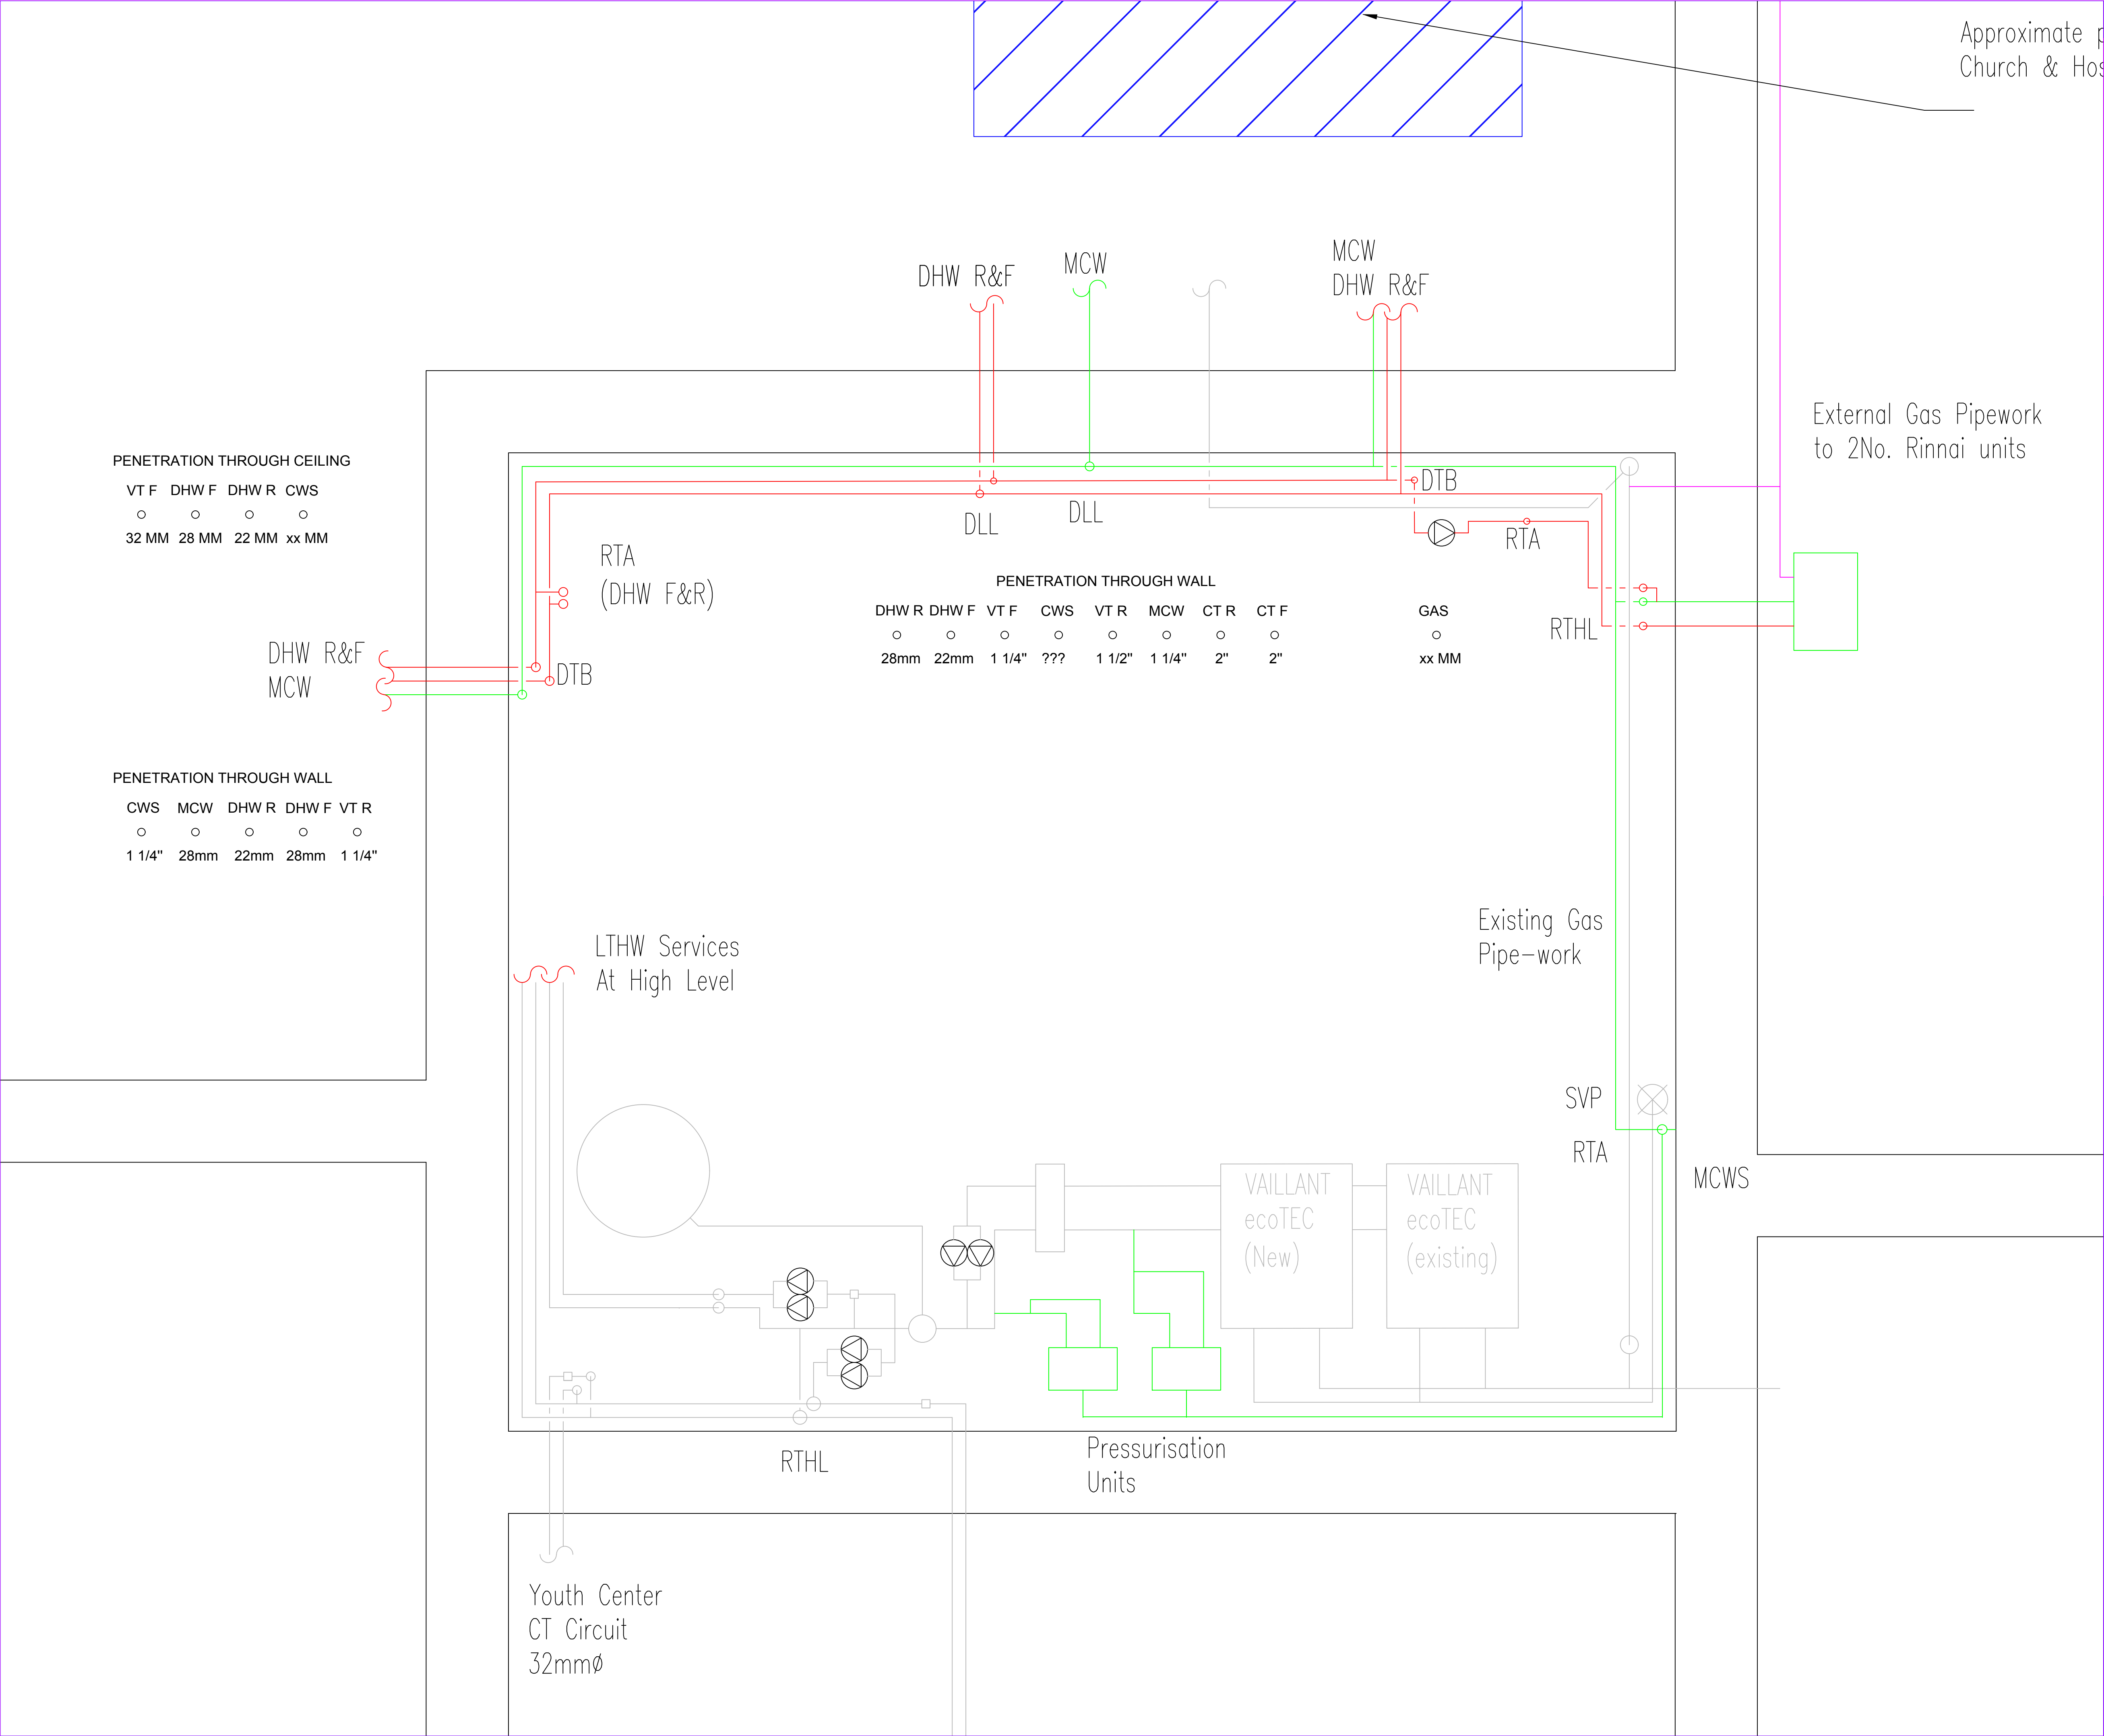

N O T E S

MV

Motorised Valve

DTLL

Drop To Low Level

RTA

Rise To Above

RFB

Rise From Below

RTHL

Rise To High Level

VT F

Low Temperature Hot Water Variable Temperature Flow

VT R

Low Temperature Hot Water Variable Temperature Return

CT F

Low Temperature Hot Water Constant Temperature Flow

CT R

Low Temperature Hot Water Constant Temperature Return

DHW R

Domestic Hot Water Return

DHW F

Domestic Hot Water Flow

MCW

Mains Cold Water

LSV

Lock Shield Valve

Flow direction Arrow

Flange End Termination

Drain Off Cock

Valve

2-Port Motorised Valve

3-Port Motorised Valve

Single Head Pump

Twin Head Pump

PRV

Pressure Reducing Valve

Gas Meter Installation with Motorised Valve

Mains Cold Water Pipework

Above Ground Drainage

LTHW Pipework

MID Class 2 Heat Meter

Rev	By	Date	Revision	PWH	AAA
/	16/05/26	Issued for approval		Chk	Apvd

VITAL

SURVEYS & BUILDING SERVICES

TITLE

Shrewsbury House
Plant room
Domestic Services Layout

PROJECT

Domestic Services Layout

CLIENT

Shrewsbury House
Youth Centre

DRAWING STATUS

PRELIMINARY

Scale

NTS

Date

16/05

Drawn

PWH

Chk.

PWH

Drg. No.

L5 3PE-ZZ-PL-M-005

Rev

-